

LED IN-GROUND LUMINAIRE

وحدة إضاءة أرضية ليد

Attentions:

- Luminaire should be installed by professional electrician.
- Check the power switch has been turned off.
- Please read this user guide carefully before installation and keep for future reference.
- If the cable or flexible external wire of this lamp is damaged, it must be replaced exclusively by the manufacturer, its service agent or a qualified technician to avoid a hazard.
- The light source in this lighting unit should only be replaced by the manufacturer, his service agent or a qualified technician.
- Terminal block not included. Installation must be carried out by a qualified technician.


تنبيهات:

- يجب أن يتم تثبيت وحدة الإضاءة بواسطة كهربائي محترف.
- تحقق من إيقاف تشغيل مفتاح الطاقة.
- يرجى قراءة دليل المستخدم بعناية قبل التثبيت، والاحتفاظ به للرجوع إليه في المستقبل.
- في حالة تلف الكبل أو السلك الخارجي المرز لهذا المصباح، يجب استبداله حصريا من قبل الشركة المصنعة أو وكيل الخدمة الخاص به أو فني مؤهل لتجنب حدوث خطر.
- يجب استبدال مصدر الضوء الموجود في وحدة الإضاءة هذه فقط من قبل الشركة المصنعة أو وكيل الخدمة الخاص به أو فني مؤهل.
- المنتج لا يتضمن صندوق التوصيل. يجب أن يتم التثبيت من قبل فني مؤهل.

| Model | ILS7.5RMOIGL02 | ILS7.5RMOIGL02 | الموديل |
|---------------------------|--------------------|--------------------------------------|--------------------------|
| Power | 7.5W | ٧,٥ واط | القدرة |
| Input Voltage & Frequency | AC220-240V,50/60Hz | تيار متردد ٢٢٠-٢٤٠ فولت، ٥٠/٦٠ هيرتز | الجهود الكهربائي والتردد |
| IP | 67 | ٦٧ | درجة الحماية |
| TA | 45°C | ٤٥ درجة | درجة الحرارة |

COMPONENTS AND TOOLS

المكونات والأدوات

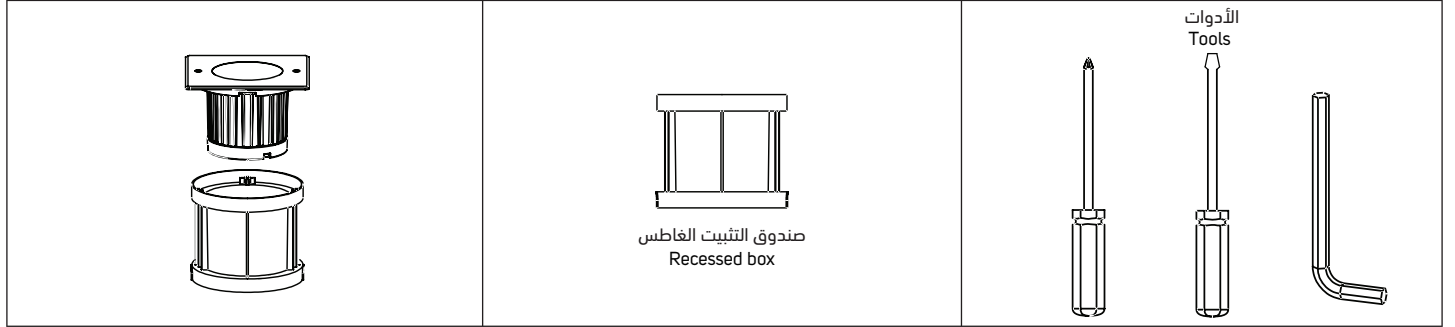

INSTALLATION STEPS

خطوات التثبيت

